

Coke Drum Workshop and Safety Seminar
Using Acoustic Emission Testing to
inspect Coke Drums
Galveston, Texas - USA

March 2009

by: Claudio Allevato

Objectives

Present basic principles and applications of acoustic emission testing (AET) when used to help assess the reliability and structural integrity of coke drums and overhead vapor piping components, while in service, out of service, and during fabrication.

2

Coke Drum Workshop & Safety Seminar



- Acoustic emission testing handbook
- www.asnt.org

Coke Drum Workshop & Safety Seminar



Chapter 4 is dedicated to AE testing of Coke Drums.

3



Why don't we start with definitions ?

- Reliability....
- Acoustic emission testing....

Coke Drum Workshop & Safety Seminar

4



What is Reliability?

- “*Reliability is defined as the probability of an item to perform a required function under specified conditions for a certain period of time.*”

From University of Maryland Web Site

Coke Drum Workshop &
Safety Seminar

5



Acoustic Emission (AE) is...

ASTM E 610

...the class of phenomena whereby transient elastic waves are generated by rapid release of energy from localized sources within a material, or the transient elastic waves so generated.

ASNT

...the elastic energy that is spontaneously released by materials when they undergo deformation.

Coke Drum Workshop &
Safety Seminar

6



How does AET work?

Principles
Description
Instrumentation
Advantages
Limitations
Standards



Coke Drum Workshop &
Safety Seminar


7



Measurement Chain

Acoustic Emission (AE)
Process

1. **Stimuli** – Global Source of energy, often mechanical load; other examples: thermal gradient, Hoop stress, etc.
2. **AE Source** – localized stress release
3. **Wave Propagation** – dynamic response of structure to AE source
4. **AE Sensor** – conversion of mechanical wave to voltage
5. **Signal Processing** –
 - Preamplifier
 - Main/System Amplifier
 - Amplification and Filtering Functions

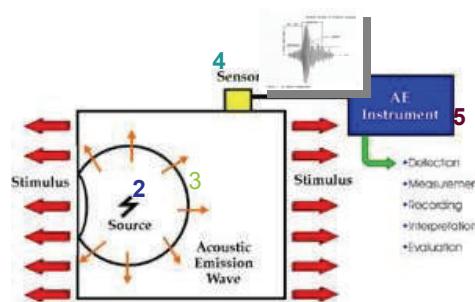

Acoustic Emissions are transient elastic waves generated by the rapid release of energy from localized sources within a material.
(Excerpted from ASTM E610-82)


Courtesy of Dr. R. Nordstrom – AEWG 2004

8

Coke Drum Workshop &
Safety Seminar



Frequency Regimes

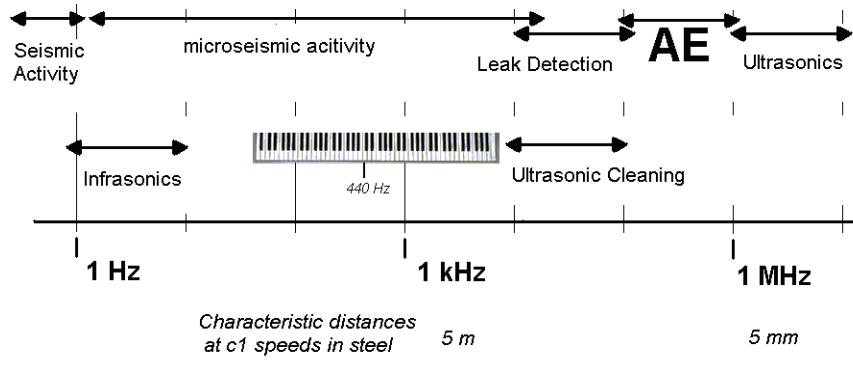

Coke Drum Workshop &
Safety Seminar

Courtesy of Dr. R. Nordstrom – AEWG 2004




AE principles

*There are primarily 2 types of AE from
“flawed” metals:*

- AE type I – Associated with plastic deformation (yielding) near stress risers
- AE type II – Associated with actual damage progression/crack propagation

Coke Drum Workshop &
Safety Seminar


10

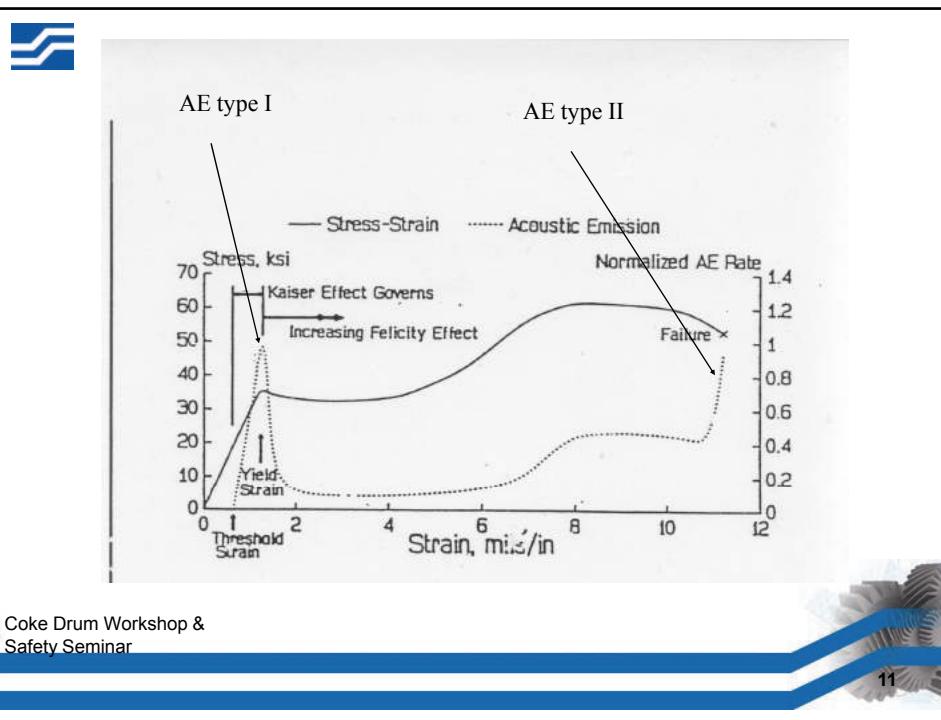

-
- **Type I AE** is used as a global screening of components, using pressure or thermal gradients to find stress risers/cracks by imposing a level of stress slightly above normal stress levels.
 - Example: In-service over-pressurization of a column or reactor to 110% of maximum operating pressure over last 12 months.
- Coke Drum Workshop & Safety Seminar
- 12



AE type I comes from elastic deformation/yielding !

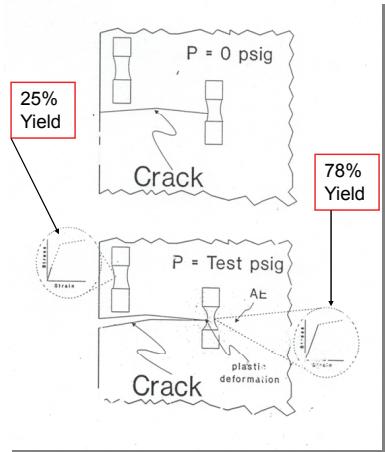

No load = No AET signals

**Under load + crack free
Material = NO AET signals**

**Under load + cracked
Material = AET signals**

13



- **Type II AE** is used to monitor and/or detect unknown/existing crack-like flaws in components, which cannot be easily overstressed. AE signals come from actual damage progression or crack propagation.
- Example: On-line monitoring of coke drums for thermally induced fatigue cracks.

Coke Drum Workshop &
Safety Seminar

14



AE type II...comes from crack propagation !



Thermally induced fatigue crack in circ. weld of a coke drum

Don't need AE to find that...

...but crack had been growing for a while.

Coke Drum Workshop & Safety Seminar

15



Advantages of AET

- Inspect 100% of the coke drum (global inspection)
- Detect growing cracks, significant to the drum's structural integrity
- Can be applied in-service
- No need to remove insulation
- Wide temperature range (Cryogenic to High temperature)
- Recognized by several standards
- Compliance with local, state & federal regulations
- Significant savings by avoiding vessel entry
- **Repeatability / Kaiser Effect**

Coke Drum Workshop & Safety Seminar

16



Limitations of AET

- .. ,
- res
- The mor
- 5 %
- In the , ..
- //!
-
-
-

Coke Drum Workshop &
Safety Seminar

17



OK,limitations of AET

- Requires experienced and skilled operator
- Qualitative results (can't size defects)
- Fairly complex and expensive hardware/software
- Needs access to circ. Welds via scaffolding or rope
- **Requires client/user to be well educated in topic**
(that's why I am here....)
- Can't find inactive flaws or old cracks. Only active ones.

Coke Drum Workshop &
Safety Seminar

18



AET Instrumentation

304 Stainless Steel waveguide
and 150kHz sensor



Vallen Digital System
Coke Drum Workshop & TÜF Certified
Safety Seminar




Four drums
Covered with
56 AET
probes
each

19



Use of waveguide avoids damaging of transducers.
Loss of 8dB at contact point is known and compensated for

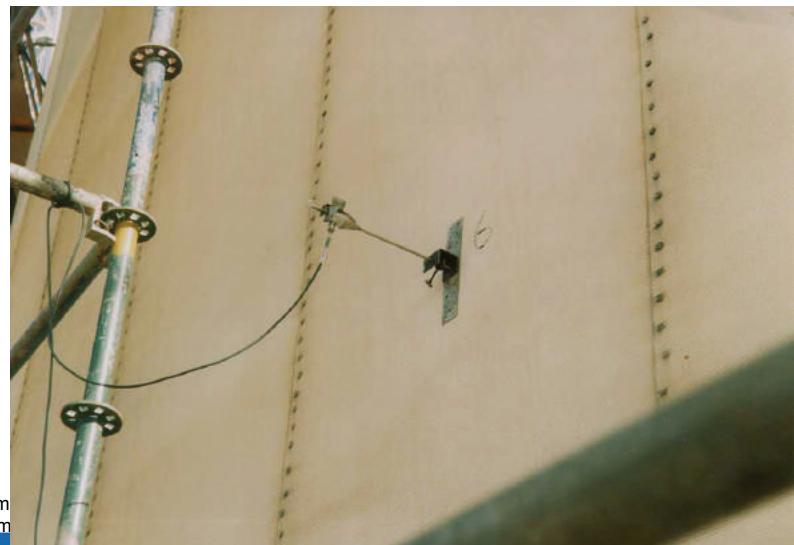

Coke Drum
Safety Sem

20



AET applied to coke drums



- During acceptance code hydrostatic pressurization
- During On-line monitoring

Coke Drum Workshop &
Safety Seminar

21



Section II

Our experience with Acoustic Emission inspection during acceptance hydrotest of new coke drums

- Sumitomo Japan: Four (two 3%Cr) new drums for Citgo Refinery
- JSW Japan: Four 2 $\frac{1}{4}$ Cr 1Mo new drums for Citgo Refinery
- Lyondell-Citgo Refinery: Four new CS drums for LCR

Coke Drum Workshop &
Safety Seminar

22



Why AET during initial hydrotest?

- To detect fabrication discontinuities, which are acceptable by Code, but are “active” at stress levels above Code Hoop Stresses.
- These are the flaws, which will eventually initiate and grow thermal fatigue cracks.
- This is the best time to repair fabrication discontinuities, and get drum Code Stamped by A.I.

Coke Drum Workshop &
Safety Seminar

23



Code AE hydrotest of new coke drums - 1st 3% Cr shell

(Code Max. Press. Modified to reach past 1 ½ Design to find smallest defect possible)



Coke D
Safety Seminar

24



AET results

- From all Japanese built coke drums I have personally inspected via AET during hydro (8)@ 2.5 x design pressure, only one fabrication flaw detected and confirmed (repaired) on 1 drum.
- From all non-Japanese built coke drums I have personally inspected via AET during normal 1.5 design pressure hydro (10), they averaged 23 fabrication flaws detected and confirmed (not all repaired).

Coke Drum Workshop &
Safety Seminar

25



AET results



Sumitomo UT inspectors checking
AET indication


Coke Drum Workshop &
Safety Seminar

Team from Sumitomo,
and Citgo Petroleum






Code AE hydrotest of new coke drums – SES' designed skirt attachment for JSW built drums for Citgo Petroleum

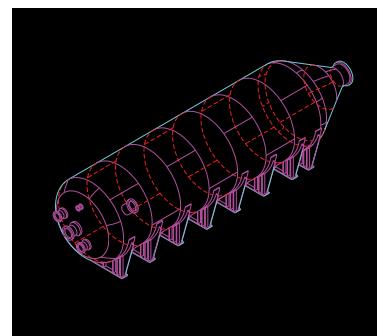

Cok
Safety Seminar

27

Hydrostatic pressurization sequence for Acoustic Emission monitoring of coke drums
326F201A/B and 326F202A/B at JSW's facilities in Muroran, Japan. Modified from
ASME Div.1 code.

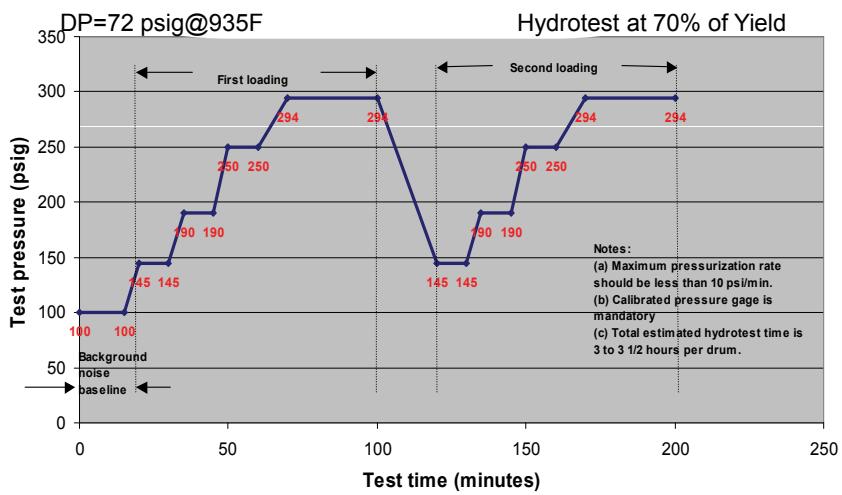


Cok
Safety Seminar

28




Section III

In-service monitoring of coke drums

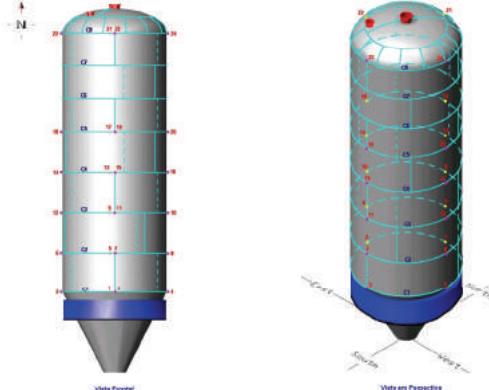

Coke Drum Workshop &
Safety Seminar

29

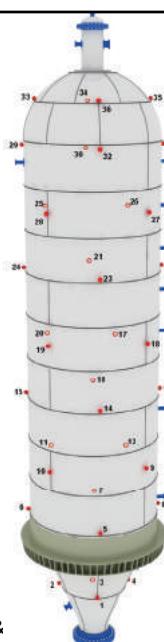

Typical AE
transducer
distribution

Coke Drum Workshop &
Safety Seminar

30



How do they fail...



Coke Drum Workshop &
Safety Seminar

Thermally induced
fatigue mechanism

Designed as Div.1
vessels, without fatigue
considerations

Costly S/D if through-
wall cracks develop

AE used to map cracks,
often with SG's and
TC's.

31



Sample of our experience with Coke Drums

In-Service Acoustic Emission/TC/Inspection


- Petrobras – Brazil, Cubatao, Sao Paulo : 4 drums, 1985
- Petrocanada – Edmonton, Canada: 2 drums, 1988
- Arco Los Angeles: 4 drums, 1990
- Frontier Refinery: 2 drums 1990
- Chevron El Segundo: 6 drums, 1994
- Amoco Whiting: 4 drums, 1994
- Citgo Lake Charles: 4 drums (Coker I), 1990
- Citgo Lake Charles: 4 drums (Coker II), 1995
- Citgo Corpus Christi: 4 drums, 1993
- Lyondell-Citgo Refinery, TX: 4 drums (Coker I), 1995
- Lyondell-Citgo refinery, TX: 4 drums (Coker II), 1996
- Conoco Ponca City: 2 drums 1998
- Conoco Lake Charles: 2 drums 1999
- Chevron El Segundo, CA: 2 drums 2002
- Exxon-Mobil Beaumont, TX: 1 drum 2003
- Valero Refinery, LA: 4 drums 2004
- Suncor, FMM – AB- 4 drums 2005
- PDVSa Venezuela – 4 Coke overhead systems 2006
- ENAP Chile 2 Coke drums 2007
- Petrobrazi – Romania 2 Coke drums 2008

Coke Drum Workshop &
Safety Seminar

32



Why drums crack?

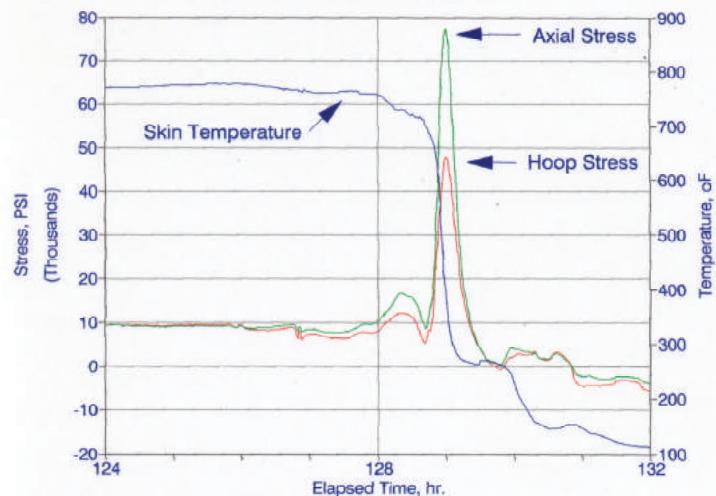

Coke Drum Safety Seminar

33



In-service acoustic emission inspection of coke drums

- Performed while in-service during regular operations.
- Uses stresses developing during thermal transients at quench and heat-up
- It relies on detecting actual crack growth due to thermal fatigue.
- Since cycles can be substantially different from each other, 3+ cycles are required to screen the drum.

Coke Drum Workshop & Safety Seminar

34




In-service acoustic emission inspection of coke drums (cont.)

- AET can separate ID from OD connected flaws by means of determining when in the cycle, crack growth occurred
- It provides full coverage of the shell, head and cone, or partial coverage focusing on known problem areas (bulges, skirt, nozzles, etc.)

Coke Drum Workshop &
Safety Seminar

35

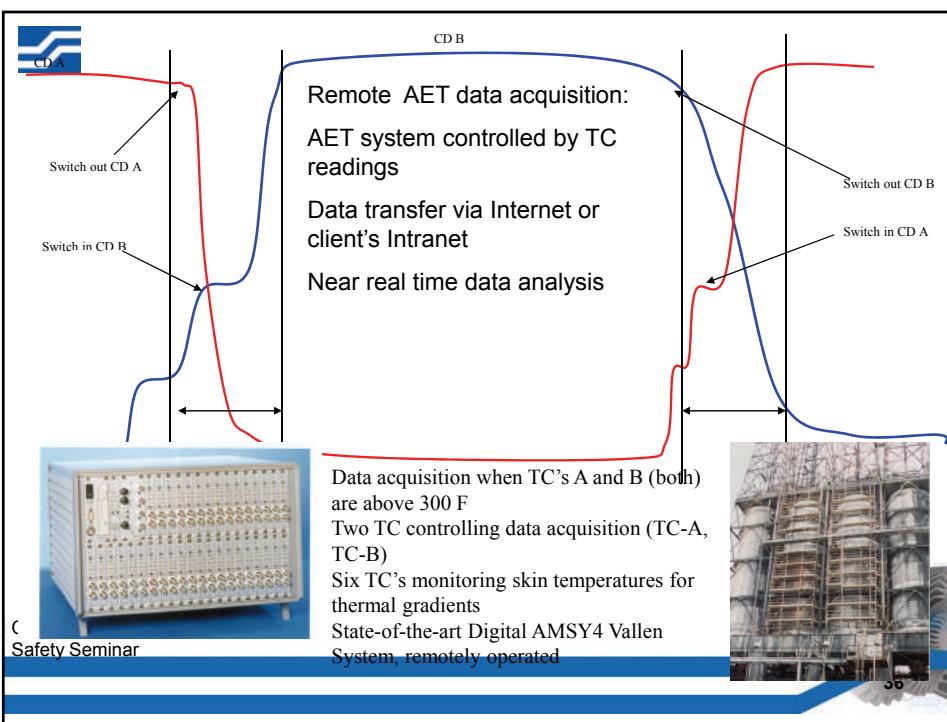




Case history 1

- Cracked skirt attachment weld
- Cracks in “key hole” slots
- Client need to know if and when skirt cracks are growing
- AE needs to separate AET signals from these 2 elevations (9” apart)



Coke Drum Workshop &
Safety Seminar

37

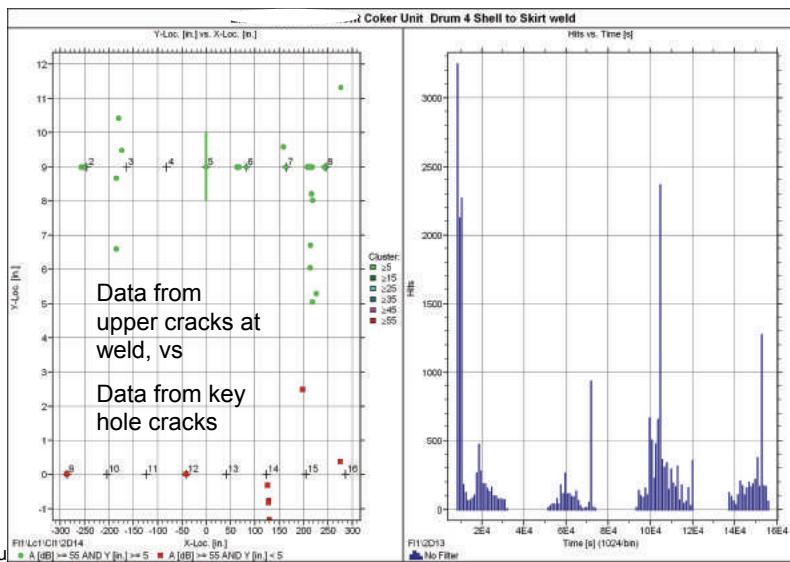

Coke Drum
Safety Seminar

38

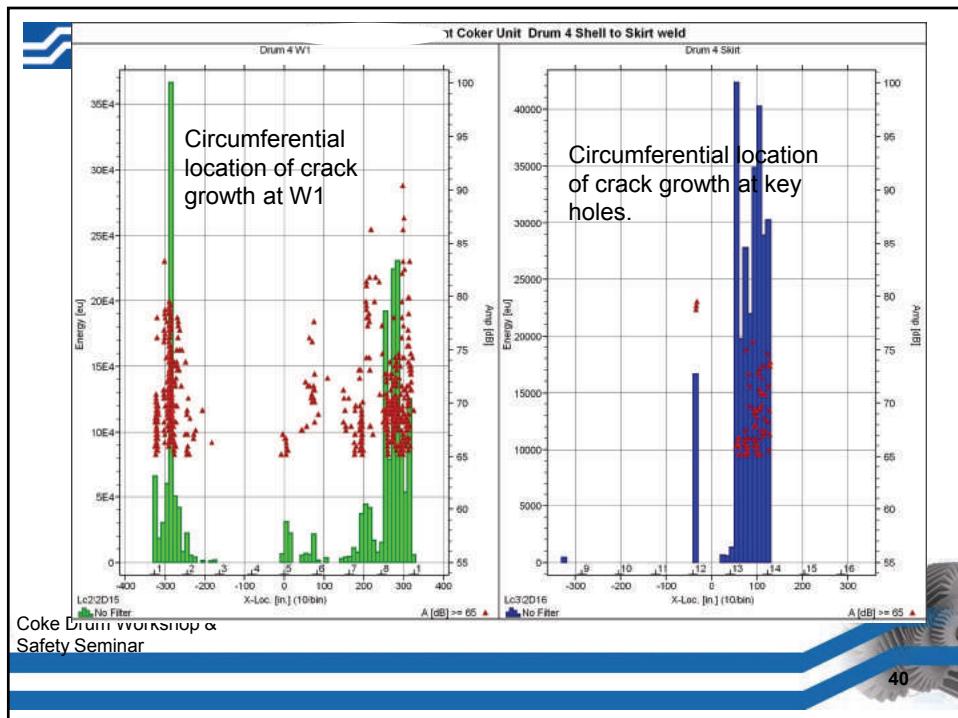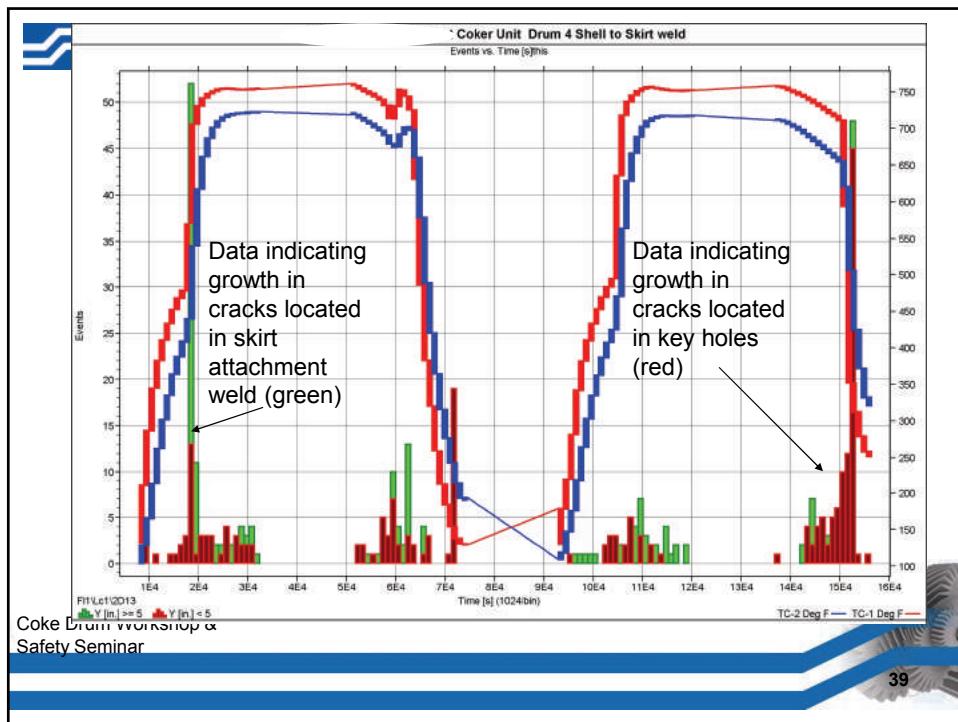



Case history 2

- In-service monitoring of coke drum for 6 cycles.
- Rare design with top derrick supported by top head by means of a cylindrical skirt.
- Significant cracking found at top skirt-to-head attachment welds
- Difficult location to inspect, not planned.

Coke Drum Workshop &
Safety Seminar


41



South drum: Location plots for runs 1-3

A123-98

Severe cracks in top
head to skirt weld

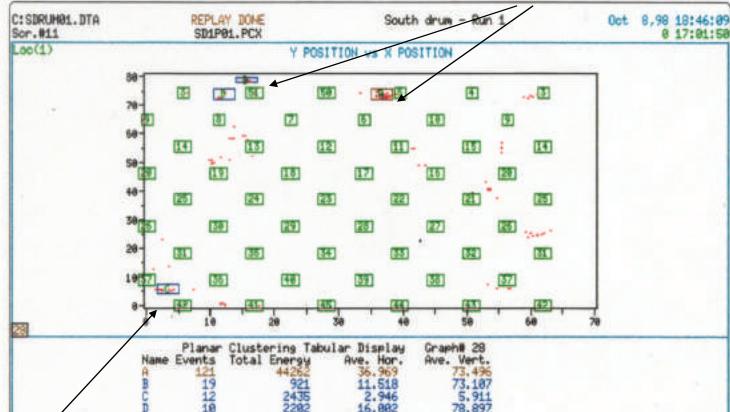

Coke Dr
Safety Seminar

42




Case study 3

- Owner wanted to investigate consequences of reducing heat-up time from 3 hr to 45 minutes
- AET and strain gages were used to measure short term (immediate) consequences
- Results indicated no significant changes on AET activity level and strain magnitudes (not a long term assessment)

Coke Drum Workshop & Safety Seminar

43

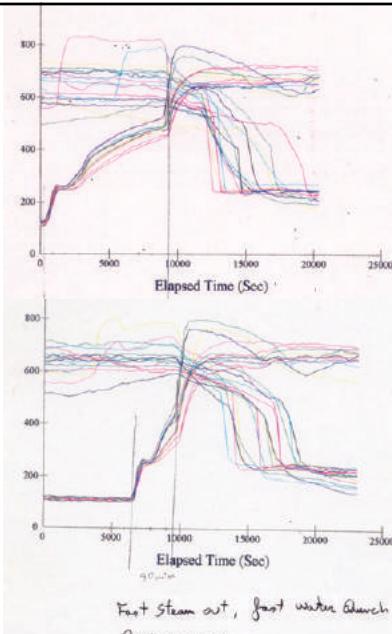

US West Coast refinery
Wanted to know what would Happen if "heat-up" times Were shortened by 2 hrs.
AET and SG indicated
No significant damage being Caused by operational change

Shell thermocouples only

Coke Drum Workshop & Safety Seminar

44




Case Study 4

- AET on-line monitoring of top head after drill stem dropped.
- Crack located by AET, and monitored for further growth for 3 weeks, until outage allowed repairs


Coke Drum Workshop &
Safety Seminar

45

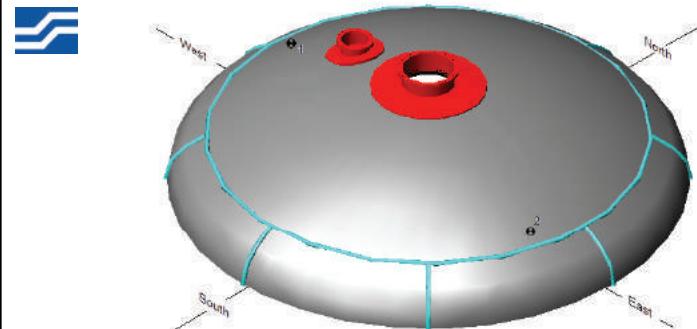

Coke D
Safety Seminar

46

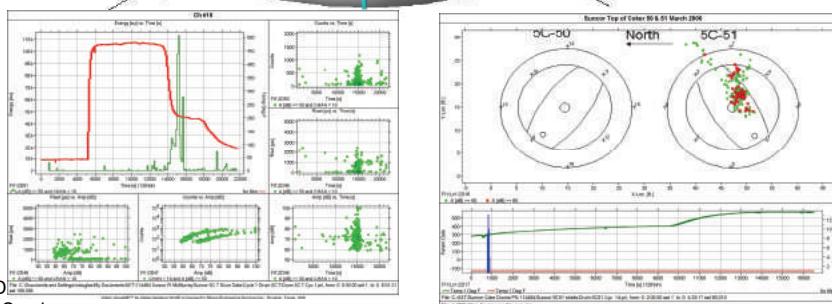



Case study 5

- New coker unit with severe vibration issues causing mechanically induced fatigue cracks on overhead vapor lines and nozzles, and foam injection piping.
- Three through-wall failures prior to AET monitoring activation on August 2006.
- AET continuous monitoring have warned of other cracks, which were promptly repaired between cycles. No other failure as of today.
- SES is currently installing mechanical remediation to reduce vibration.

Coke Drum Workshop &
Safety Seminar

47



Four coker unit




Coke Drum Workshop &
Safety Seminar

48



Overhead piping system in Coker Unit subjected to vibration induced fatigue cracking

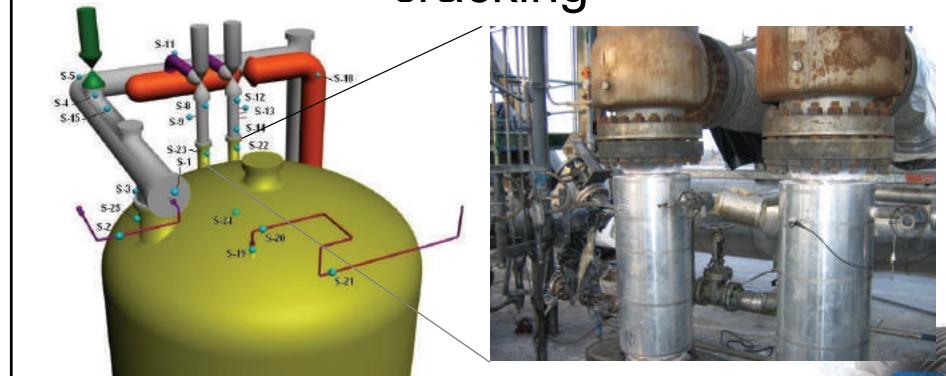

Coke Drum Workshop & Safety Seminar

49



Coke Drum Workshop & Safety Seminar

50



Conclusions

- Acoustic emission inspection can screen existing or new coke drums to detect and locate existing crack-like or significant flaws
- It can have a positive impact on T/A planning and budget by reducing and optimizing NDT efforts
- It can predict failure locations, therefore avoid costly shutdowns

Coke Drum Workshop &
Safety Seminar

51



Conclusions (cont.)

- Plants need to maintain critical units operational, despite presence of significant flaws.
- There is a wide array of NDE methods available to plant owners/operators to help achieve that objective.
- On some cases AET can provide the necessary information and data to allow for safe continued operation until other actions can be implemented.

Coke Drum Workshop &
Safety Seminar

52



Claudio Allevato
Stress Engineering Services, Inc.
Houston, Texas - USA
ca@stress.com
(281) 955 2900

Coke Drum Workshop &
Safety Seminar

53